






BATTURE
INC.
REGISTERED PROFESSIONAL ENGINEER
STATE OF LOUISIANA
NO. 145,282
EXPIRES 12/31/2025



SCALE 1"=20' (22x34)
SCALE 1"=40' (11x17)

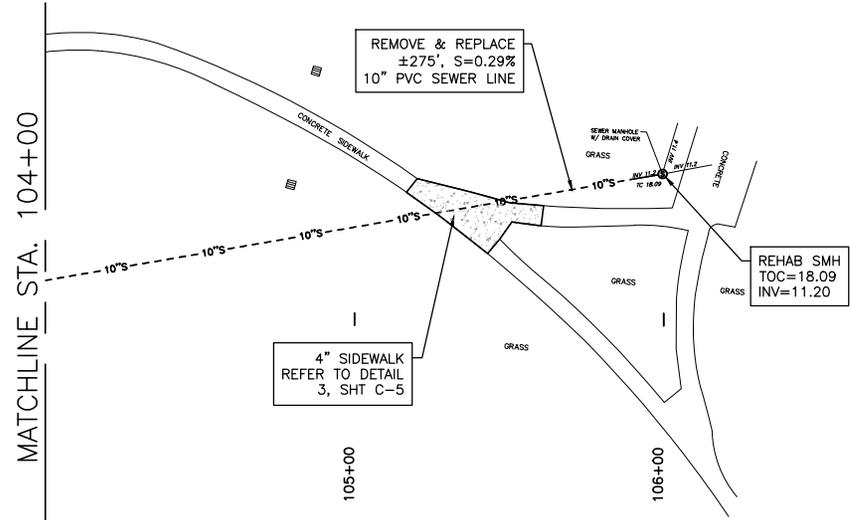

- NOTES:**
- SEWER CONNECTIONS, PIPE, AND MANHOLES SHALL BE IN ACCORDANCE WITH THE NEW ORLEANS SEWERAGE AND WATER BOARD SPECIFICATIONS AND PLUMBING CODE.
 - NO MECHANICAL TRENCHING WITHIN TREE DRIP LINE. CONTRACTOR TO UTILIZE AIR-SPADING EXCAVATION.
 - CONTRACTOR SHALL PROVIDE A TEMPORARY SEWER BYPASS SYSTEM AS NECESSARY TO MAINTAIN CONTINUOUS SEWER SERVICE DURING INSTALLATION OF NEW SANITARY SEWER LINES. BYPASS SYSTEM SHALL BE INSTALLED AND OPERATED IN ACCORDANCE WITH ALL LOCAL, STATE, AND FEDERAL REQUIREMENTS.

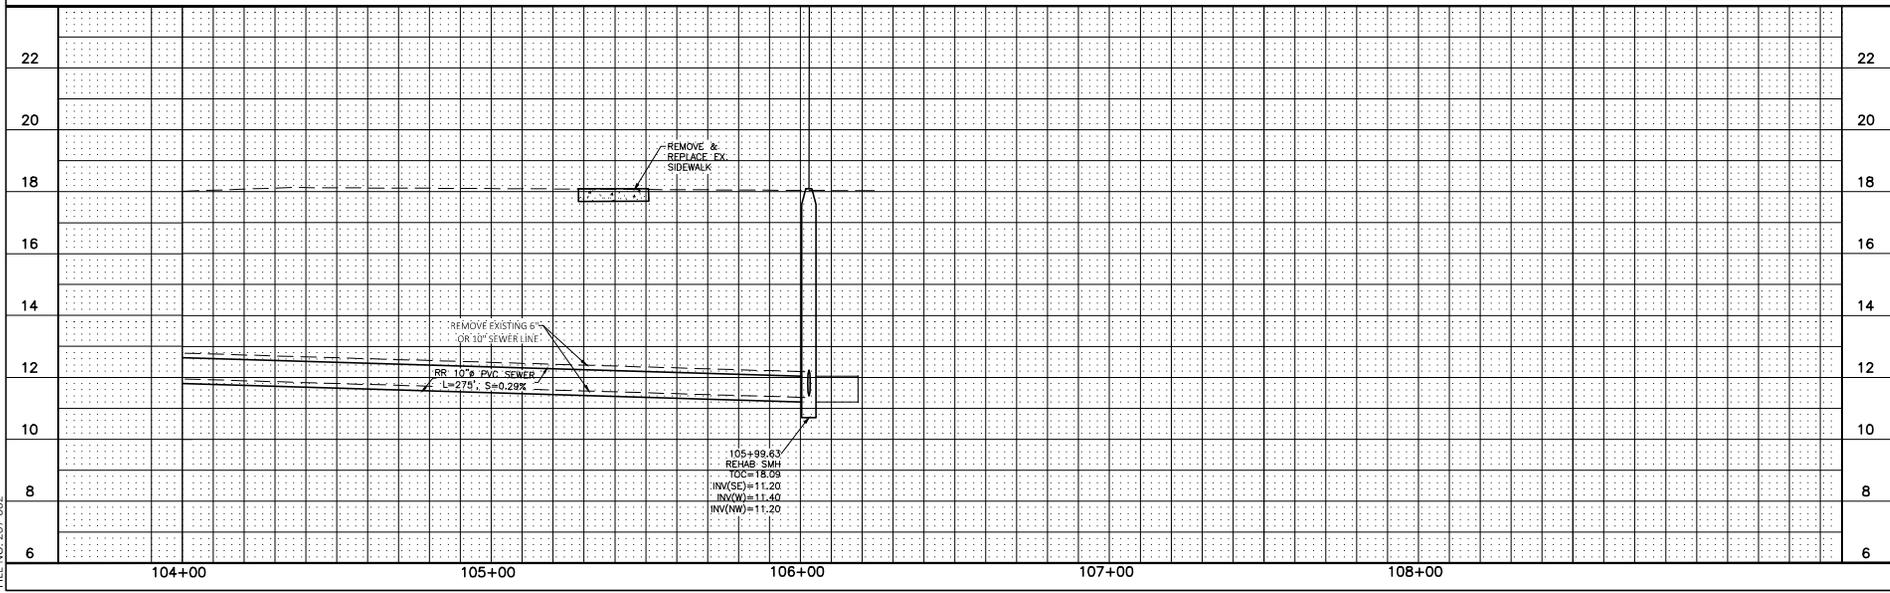


REV. NO.	DATE	DESCRIPTION

CITY PARK SEWER REPLACEMENTS
 NEW ORLEANS, LOUISIANA

DRAWN BY:
BATTURE
CHECKED BY:
BATTURE
DATE:
AUGUST 02, 2025
SHEET:
CONSTRUCTION




PROFESSIONAL OF RECORD
 UTILITY PLAN
 SHEET NUMBER:
 C-4

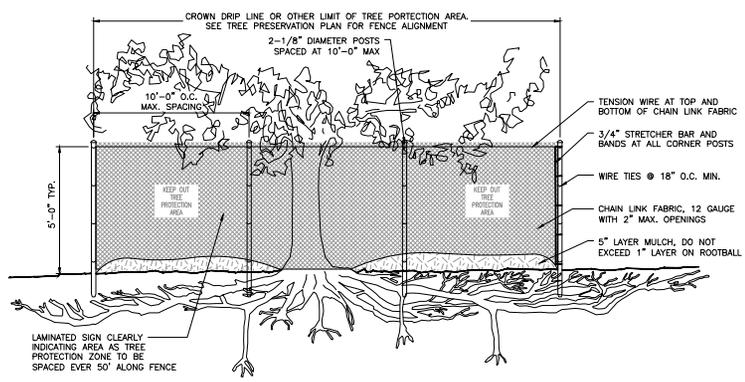


- NOTES:**
1. NO PRUNING SHALL BE PERFORMED EXCEPT BY APPROVED ARBORIST.
 2. NO EQUIPMENT SHALL OPERATE INSIDE THE PROTECTIVE FENCING INCLUDING DURING FENCE INSTALLATION AND REMOVAL.

1 TREE PROTECTION FENCING
NOT TO SCALE

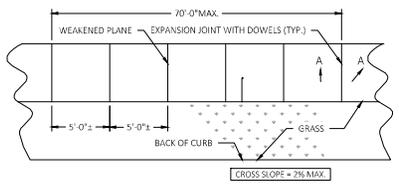

- SIDEWALK NOTES:**
1. SAND SUBBASE SHOULD BE COMPACTED TO 95% OF ITS MAXIMUM DRY DENSITY NEAR OPTIMUM WATER CONTENT USING ASTM D 1557.
 2. COMPACTED SAND (I.E. RIVER SAND) SHALL BE NON-PLASTIC AND FREE OF ROOTS, CLAY LUMPS, AND OTHER DEleterious MATERIALS WITH NO MORE THAN 10% BY WEIGHT OF MATERIAL PASSING A U.S. STANDARD NO. 200 MESH SIEVE. MAXIMUM ORGANIC CONTENT SHOULD NOT EXCEED 0% BY WEIGHT. PRIOR TO TRANSPORTING FILL TO THE SITE, A SAMPLE SHOULD BE TESTED TO VERIFY ITS CONFORMANCE TO THESE REQUIREMENTS.
 3. GEOTEXTILE STABILIZATION FABRIC SHALL MEET OR EXCEED THE MATERIAL REQUIREMENTS IN SECTION 1019.01 OF THE LSRRB. A CLASS C GEOTEXTILE SHOULD BE USED AND PLACED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
 4. SUBGRADE PREPARATION - AFTER STRIPPING, CLEARING, AND DEMOLITION OPERATIONS, THE EXPOSED GROUND SHOULD BE PROOTROLLED WITH A BULLDOZER, COMPACTOR, OR TRACKED VEHICLE EXERTING A GROUND PRESSURE BETWEEN 10 AND 15 PSI. THE VIBRATORY SYSTEM ON THE COMPACTOR, IF PRESENT, SHOULD NOT BE USED DURING PROOTROLLING. ANY WEAK AREAS SHOULD BE REMOVED AND BACKFILLED WITH COMPACTED SAND. CLEARING AND COMPACTION OPERATIONS SHALL ONLY BE PERFORMED DURING PERIODS OF DRY WEATHER.

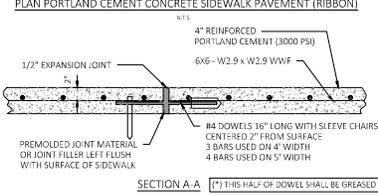

3 4" CONCRETE SIDEWALK
NOT TO SCALE

REV. NO.	DATE	DESCRIPTION

**CITY PARK
SEWER REPLACEMENTS**
NEW ORLEANS, LOUISIANA

DRAWN BY:
BATTURE
CHECKED BY:
BATTURE
DATE:
AUGUST 02, 2025
SHEET:
CONSTRUCTION



PREFERENTIAL OF RECORD
https://www.batture.com
DETAILS
SHEET NUMBER:
C-5